


ANNEX 21I

SMOKE ALARM - REACTION GUIDANCE

While it is impossible to provide rigid routines due to differing circumstances, (number of zones sounding, locations, sighted smoke, heat etc) the guidance in [Fig 21I-1](#) should be reflected in Ships CBRNDC Orders, adapted as necessary to suit the fitted smoke alarm systems.

Fig 21I-1. Smoke Alarm Reaction Guide

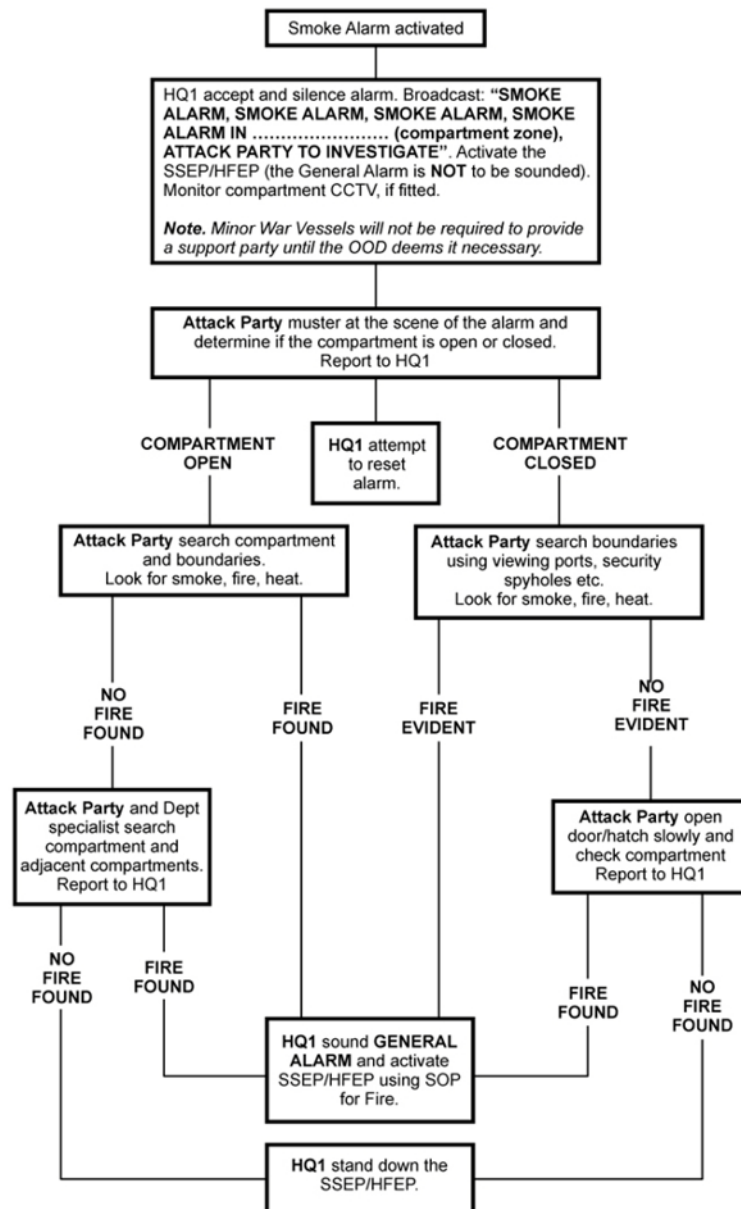

Note. In older ships, with the high voltage smoke alarm system, the HQ1 alarm must be accepted and reset at the first stage of the procedure.